



Fael Security Srl
Via E. Majorana
72100 Brindisi - ITALIA
Tel. 0831-546563 Fax 0831-546674
E-mail: fael@fael.com
Web: http://www.faelsecurity.com

El₂ 120 SLIDING DOOR "CROSSWALK 120"

Marked according to EN 16034:2014 and 13241:2016

- Fire rated sliding door for internal use and covered areas.
- Install in a draught-free environment.
- Installation to be made only by specialised personnel.
- Install on plumb and coplanar compartments or structures.




Client: _____

CTR.N°: _____ dd _____


S1_P1s.en

(Sheet Mod. 850-A)

Front View

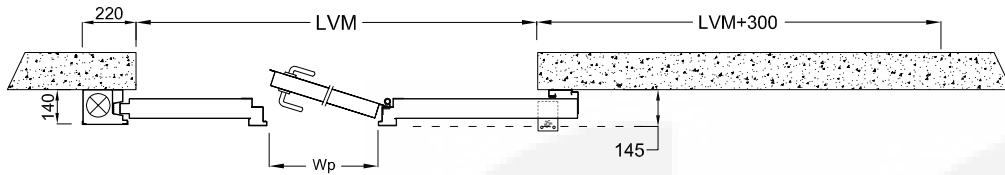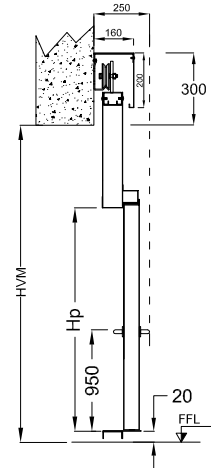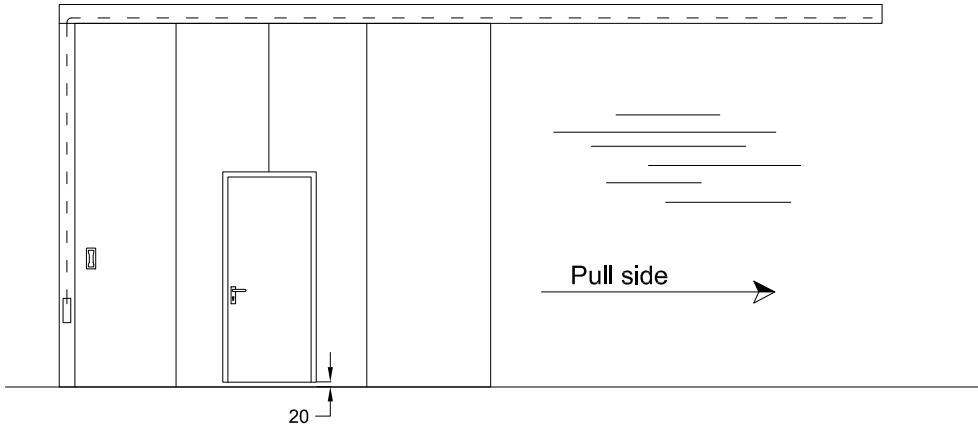

LVM = Structural Opening Width
HVM = Structural Opening Height
Wp = Passage Width (door)
Hp = Passage Height (door)
FFL = Finished Floor Level



Pedestrian Door Push side

Example of sliding door front view pull right with insertion of pedestrian door push right

Pedestrian door push side

<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> Wp.= 950 x Hp.= 2020
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> Wp.= 1200 x Hp.= 2020
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> Wp.= 950 x Hp.= 2120
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/> Wp.= 1200 x Hp.= 2120

Push Left Push Right

ACCESSORIES

MANDATORY

Electromagnet + push button release	<input type="checkbox"/>
Double Electromagnet + push button release	<input type="checkbox"/>
Radial Damper	<input type="checkbox"/>
Double Radial Damper	<input type="checkbox"/>
Shock absorber	<input type="checkbox"/>
Double Shock absorber	<input type="checkbox"/>

PEDESTRIAN DOOR

Couple of handle	<input type="checkbox"/>
Push-bar (black body and red bar)	<input type="checkbox"/>
Vision Panel dim. 300x400 mm	<input type="checkbox"/>

Note: Handle/panic bar height = 950 mm

OPTIONALS

Counterweight postponed	<input type="checkbox"/>
Smoke Tightness Sa (EN 1634-3:2005)	<input type="checkbox"/>
Night Lock (External application)	<input type="checkbox"/>
Detector (smoke and heat) RFC	<input type="checkbox"/>
Single zone fire Alarm RFC/C	<input type="checkbox"/>

RAL: _____


Note

Note: Anchoring screws for the structure are **NOT** included.


Sliding door pull side

LVM = _____ mm x HVM = _____ mm


Sliding door one leaf Qty: _____

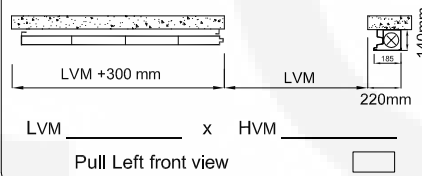


Sliding door one leaf Qty: _____

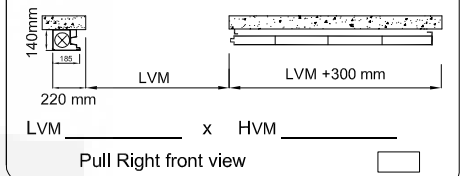


Sliding door one leaf (rebated) Qty: _____

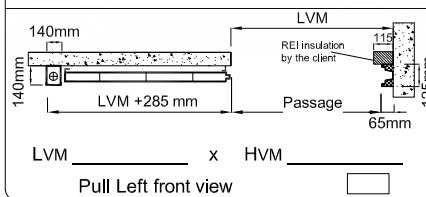


Sliding door one leaf (rebated) Qty: _____

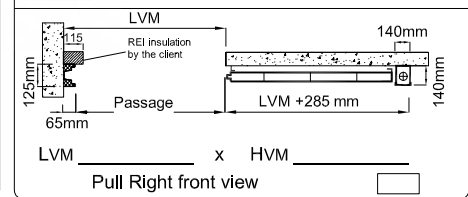


Section Vertical

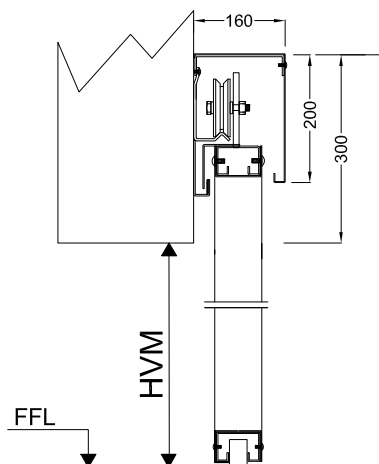

Standard Assembly



Mounting on Beam



Date -- Stamp and Signature